

Marsh Drive Bridge at Walnut Creek Replacement Project

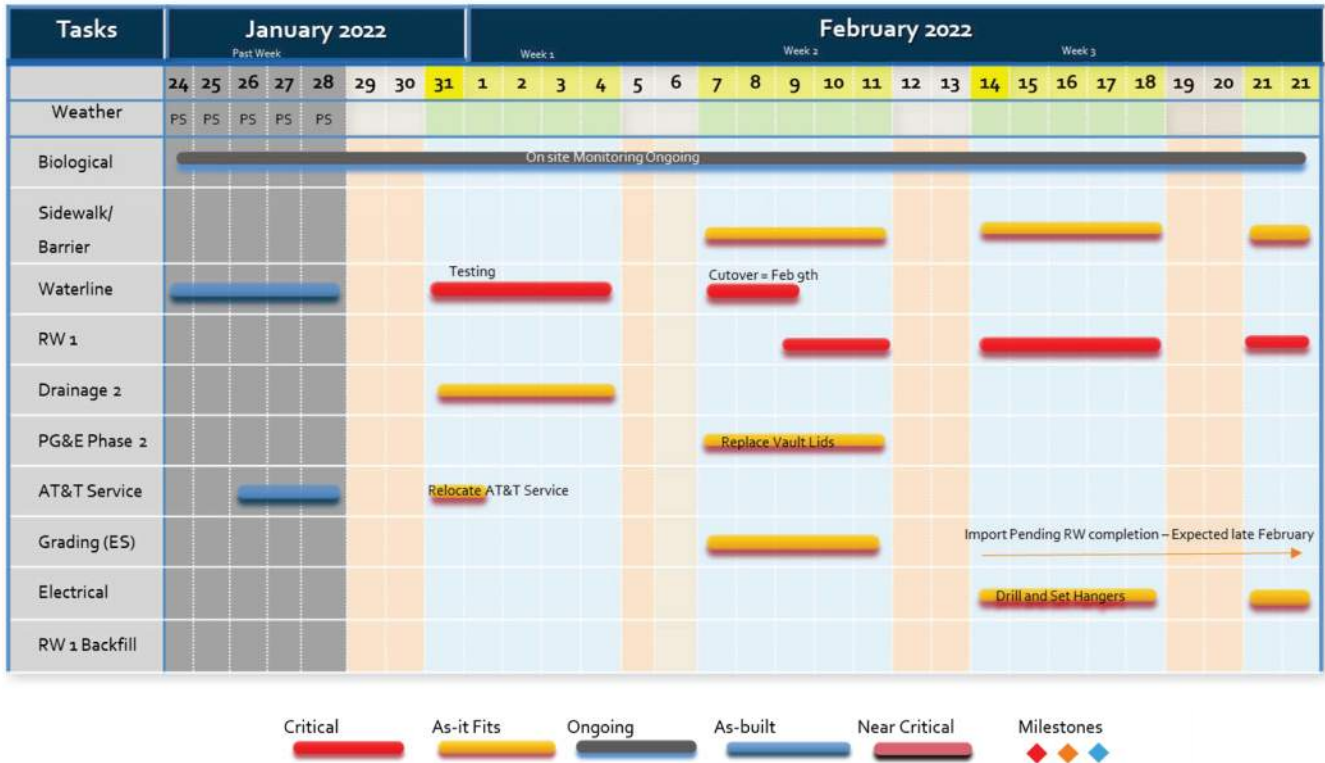


Figure 1 – Weekly Look-ahead Schedule



Figure 2 – Drainage System 2 – Temporary Shoring System



Figure 3 – AT&T 5000 Marsh Service Relocation



Figure 4 – CCWD Waterline – Tamper Switch Conduit + 2” and 4” Water Service Lines

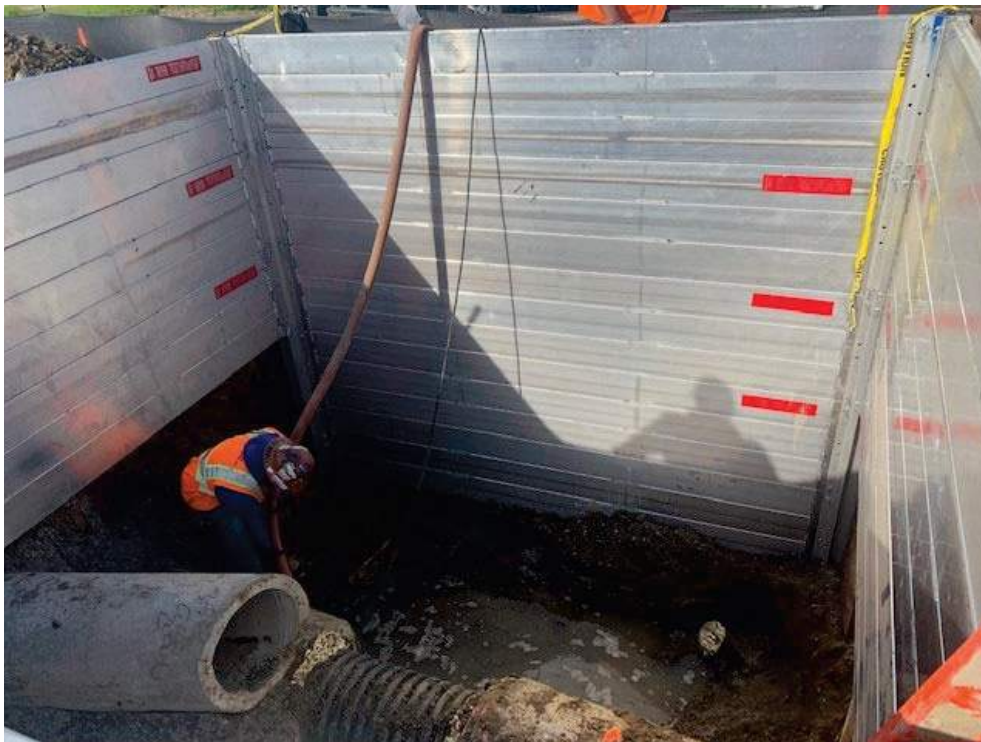


Figure 5 – Drainage System 2 – Shoring and Pumping Groundwater