

Figure 1 – Weekly Look-ahead Schedule



Figure 2 – Crews Install Silt Fence

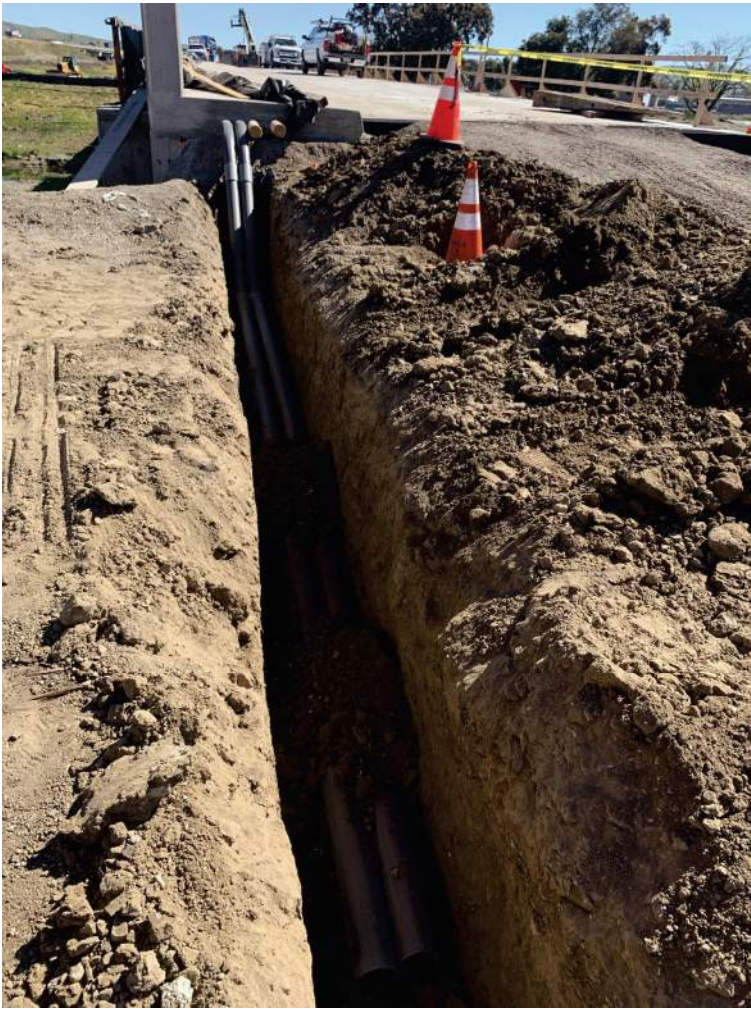
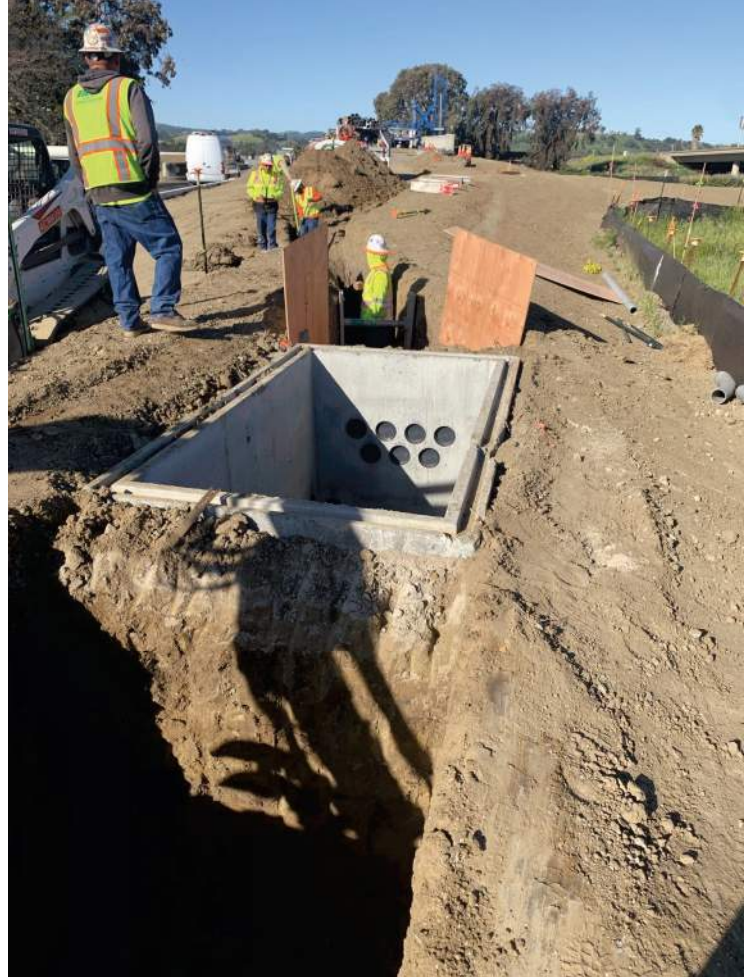


Figure 3 – AT&T Conduit (Westside)



**Figure 4 – PG&E Conduits (Eastside)**



**Figure 5 – CCWD Emergency Shutoff Valve Adjustment to Grade**